


FIRE ACTIVITY REPORT

City of Malibu | April 2026

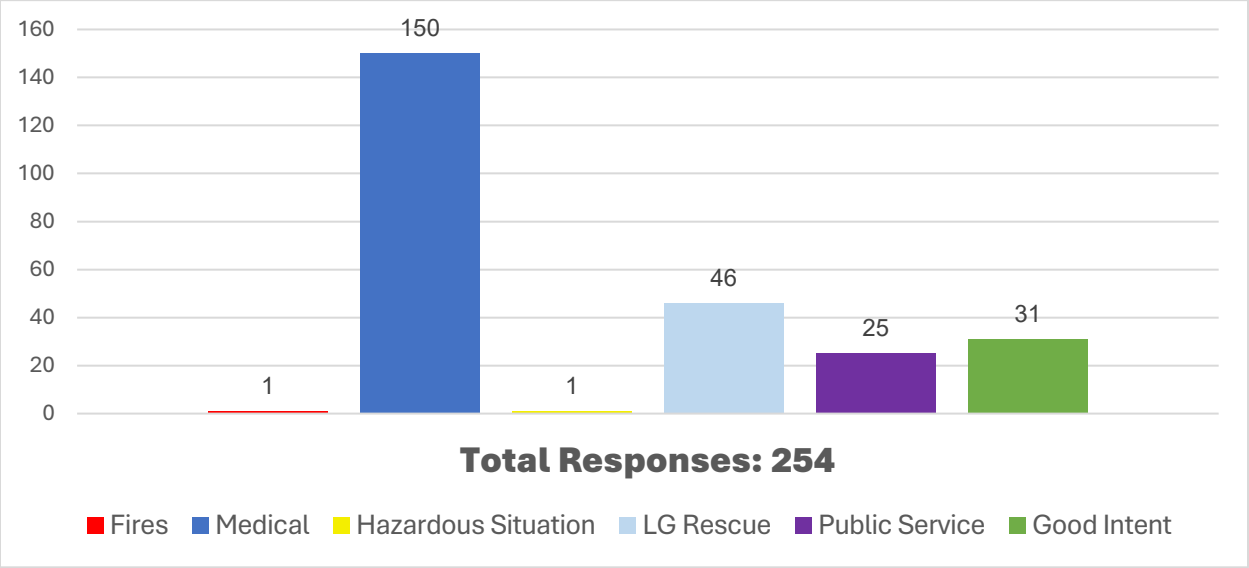

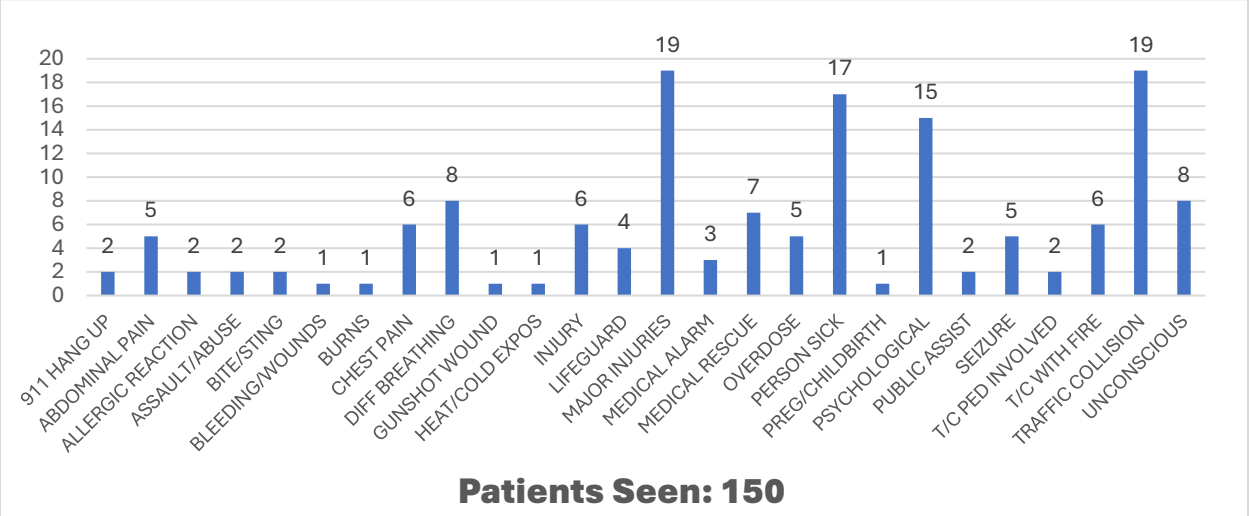

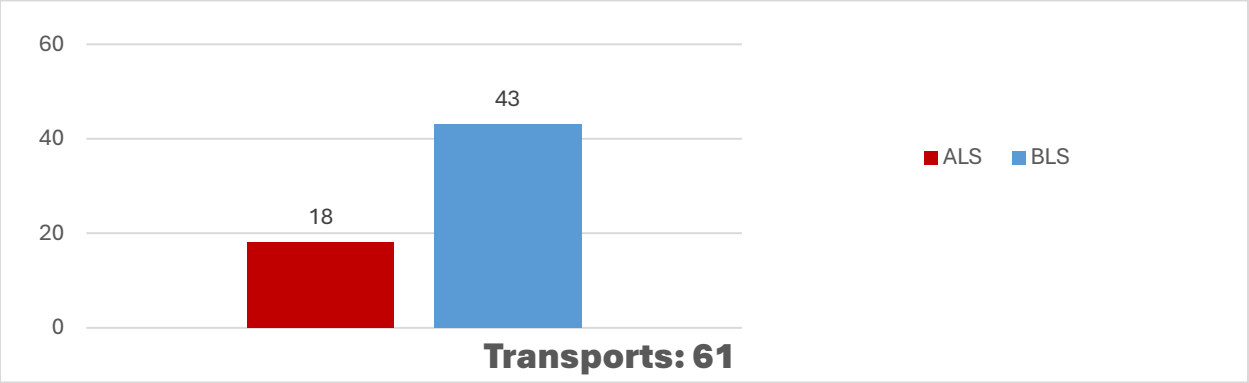

Advanced Life Support (ALS) Transports: patient transported to hospital in ambulance with paramedic on board;
Basic Life Support (BLS) Transports: patient transported to hospital without paramedic on board

FIRE ACTIVITY REPORT

City of Malibu | April 2026

Fire Incidents:

Date	Type	Address	Narrative
04/27/26	**Structure Fire**	29055 GRAYFOX	E71 arrived to find residents outside of their home stating that they returned home to find the smell of what they thought to be electrical fire and light smoke haze inside their home. No fire alarms were active. Upon investigation it was confirmed that there was the smell of electrical smoke inside the home. The circuit breakers were checked and all breakers were in the appropriate ON position and appeared normal. The attic was checked which was visibly clear and showed no signs of abnormal heat signatures with the thermal imaging camera. All rooms were checked in the home and thermal imaged with nothing presenting abnormally. The smell of the smoke was narrowed to a room in which the smell was the strongest. Within the room a small refrigerator was plugged into the wall, hot on the inside and smelled of the electrical smell. After thorough investigation of the home the refrigerator was believed to be the source of the smoke and burning smell. It was removed from the home and the residents were advised to leave the windows/doors open to continue ventilating the home. Prior to E71's departure the residents were advised to recontact 911 should the smell or smoke begin to increase in the home at any point.

Other Incidents:

Date	Type	Address	Narrative
04/15/26	**Haz Sit**	29211 HEATHERCLIFF	E71 arrived to find bank personnel outside of the business stating that there had been an abnormal smell coming from the air conditioning ducting prompting the call to 911. Upon entering the building there was a very faint odor emitting from the ceiling vent toward the rear of the business. E71 personnel then laddered the building to inspect the air conditioning units. No abnormal circumstances were observed, no smell coming from the A/C units, no abnormal heat signatures on the thermal imaging camera, no smoke or damage. An issue was observed with a separate A/C unit on the roof which was repeatedly attempting to switch on with no motor activity. The power was isolated to this unit.